

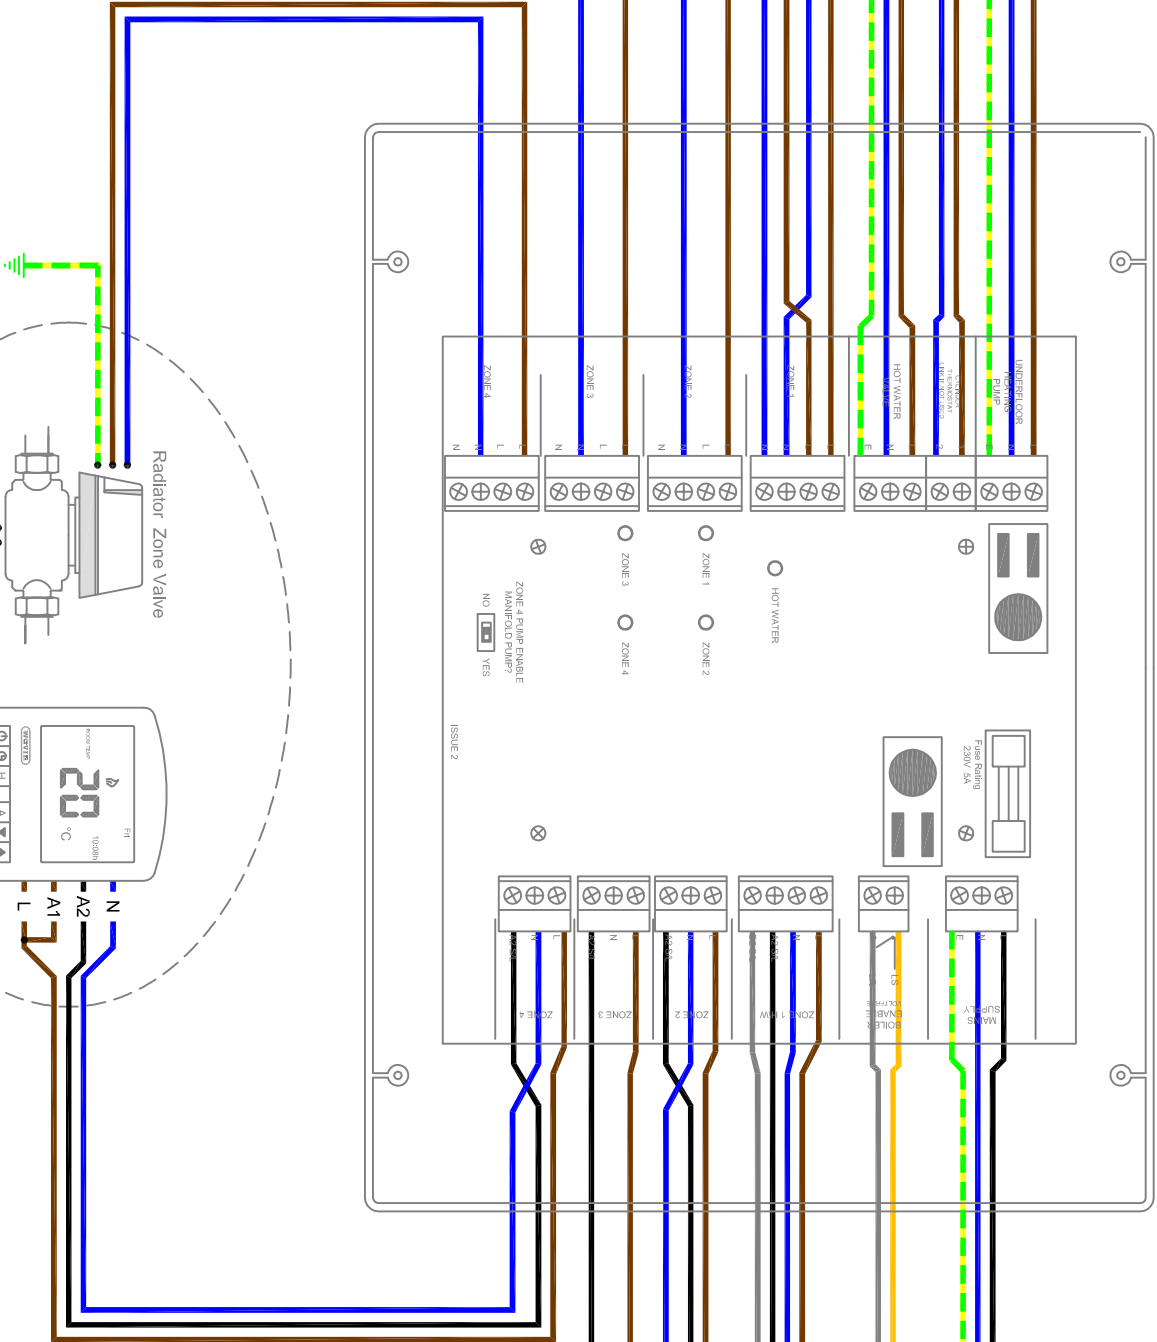
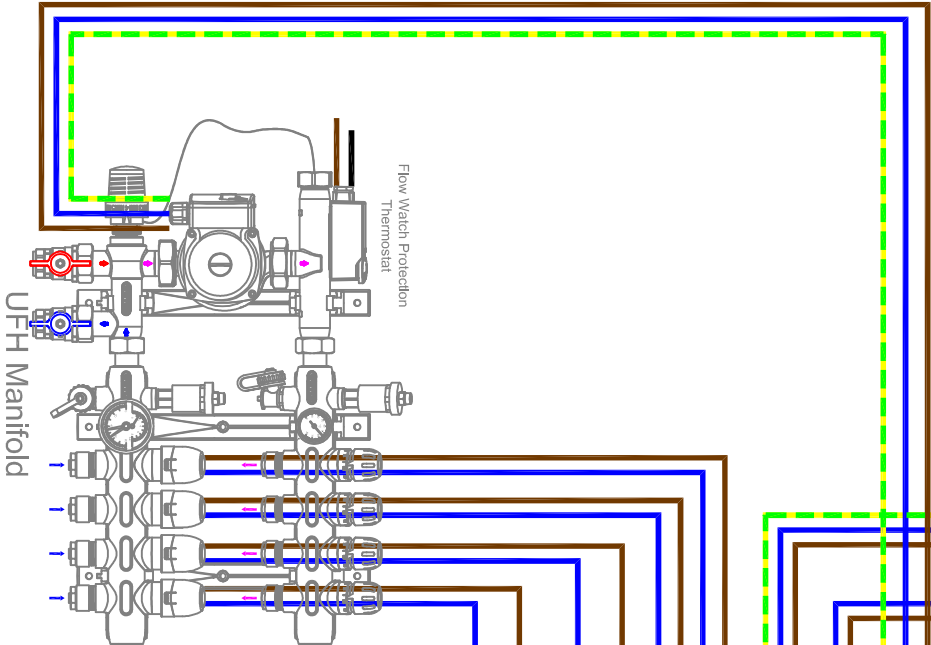


Integrated Hot Water Control
(Optional)


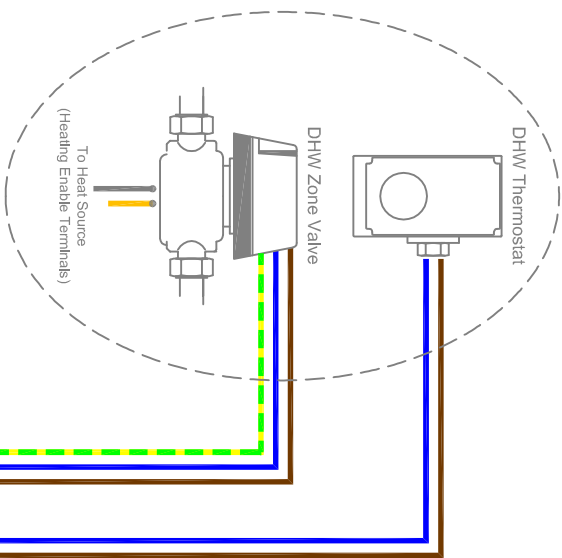


230V AC Supply In
(Via Heating/Hot Water System Fused Spur)


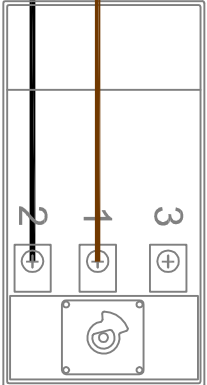


Flow Watch Protection Thermostat
Set 10°C Above Operational Temperature

To Heat Source
(Heating Enable Terminals)

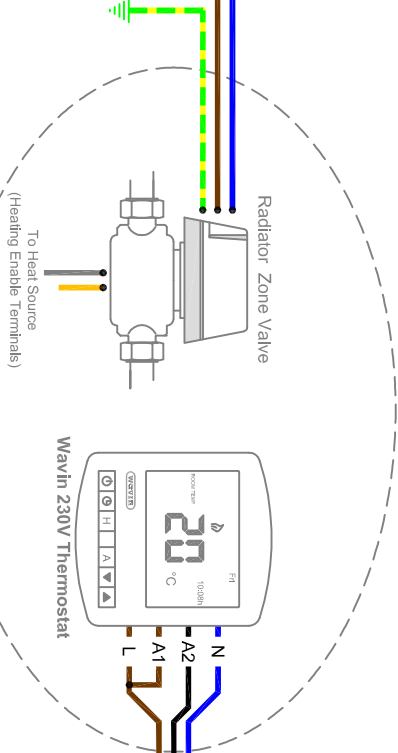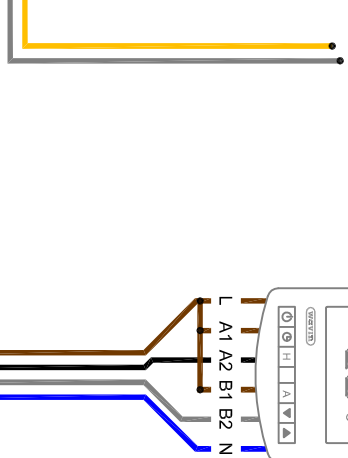

Integrated Radiator Control
(Optional)
(Set "Stat 4 Pump Enable" Switch To "NO")

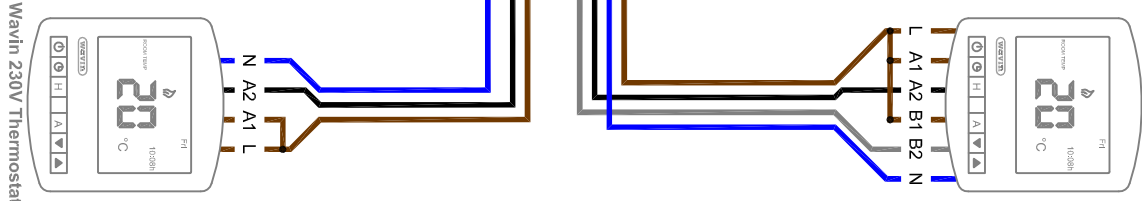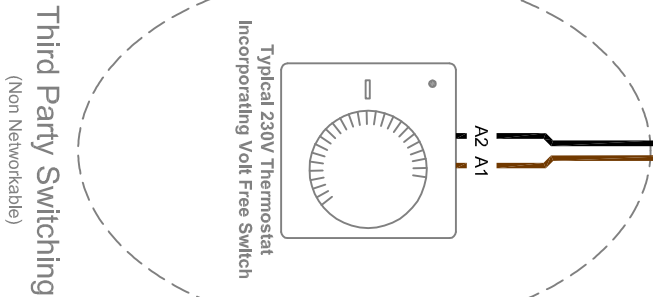

All components must be installed and earthed in accordance with local regulations.

Only competent persons with certification recognised under Building Regulations - Part P should carry out electrical installation or servicing work.