


Where Wavin 24V Bus thermostats are to be installed they will require 2 Core UTP Cable in lengths not exceeding 200m.

The connection polarity is irrelevant and the thermostats can be connected in any sequence on a single cable, or have their own dedicated cable if desired.

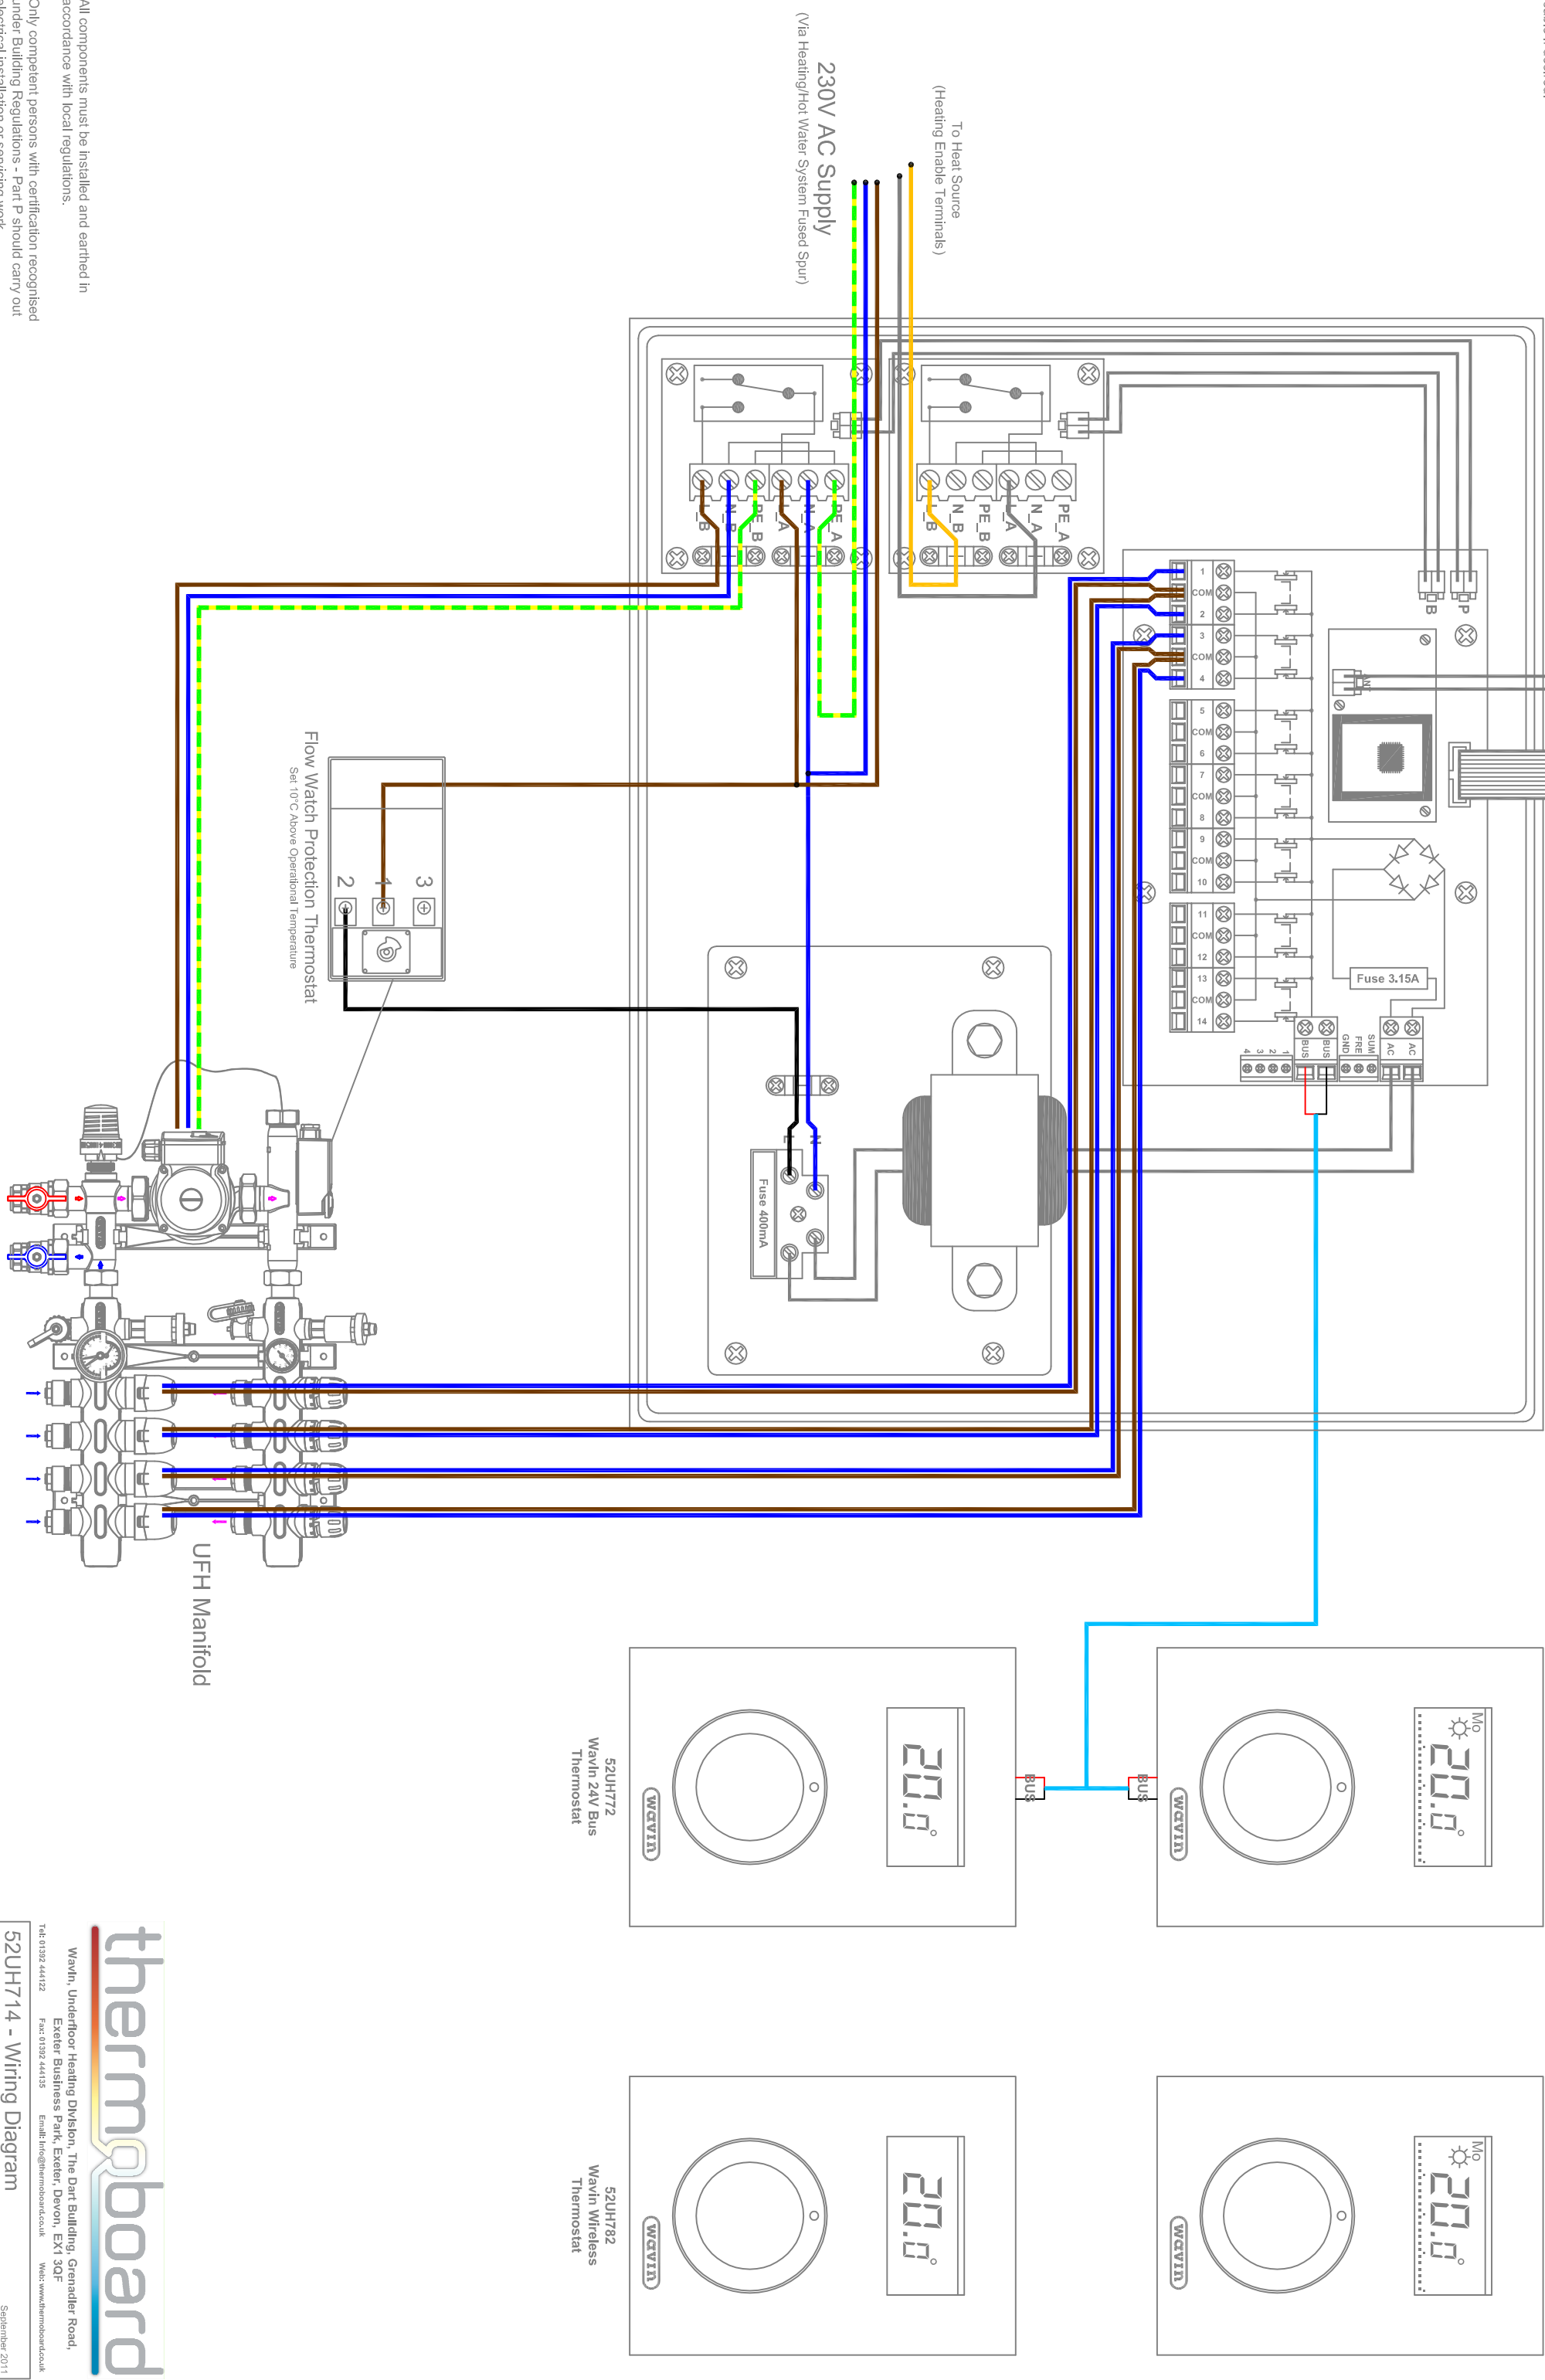

All components must be installed and earthed in accordance with local regulations.
Only competent persons with certification recognised under Building Regulations - Part P should carry out electrical installation or servicing work.

Where Wavin 24V Bus thermostats are to be installed they will require 2 Core UTP Cable in lengths not exceeding 200m.

The connection polarity is irrelevant and the thermostats can be connected in any sequence on a single cable, or have their own dedicated cable if desired.

An automatic bypass valve should be provided in conjunction with any requirements for a minimum pipe length specified in the boiler manufacturer's instruction.

